


WATER SERVICE LINE AND METER VAULT (AS SHOWN BELOW) PROVIDED BY CUSTOMER. INSTALLATION OF METER BY CITY. METER COST PAID BY CUSTOMER.

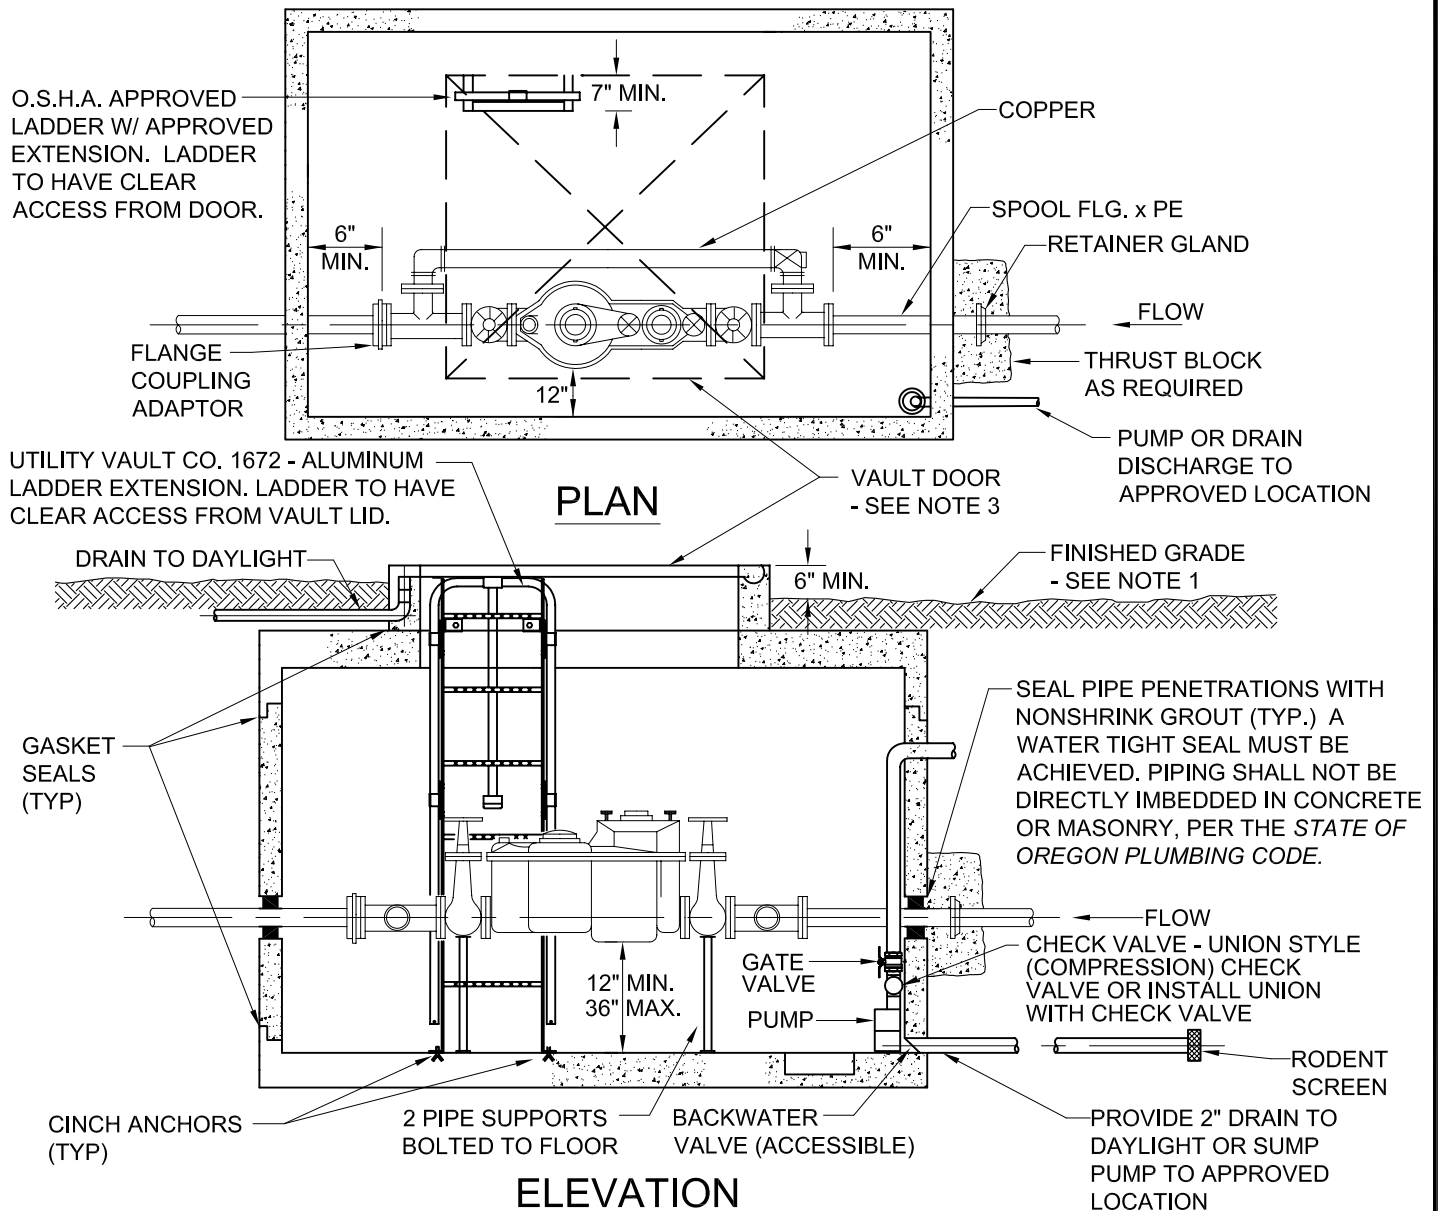

METER SIZE	UTILITY VAULT CO. - VAULT MODEL NO.	BILCO - VAULT DOOR MODEL NO.
3"	676-WA	J-5AL
4" & 6"	687-WA	J-5AL
8"	810-LA	JD-3AL

NOTE:

1. Finished grade shall slope away from the vault cover so as to prevent ponding around the cover.
2. This is to be a public facility, governed by *UPC* and *Oregon Dept. of Human Services*, as applicable.
3. Vault door mechanisms shall not project below the ceiling of the vault interior.



City Of Beaverton

**ENGINEERING
DEPARTMENT**

UTILITIES ENGINEER
David A. Winship, P.E.

DATE
6 - 10 - 04

**COMPOUND WATER
METER VAULT**

DRAWN BY
CDH - WD

DRAWING NO.
665